

PROCESS HEAT TRANSFER

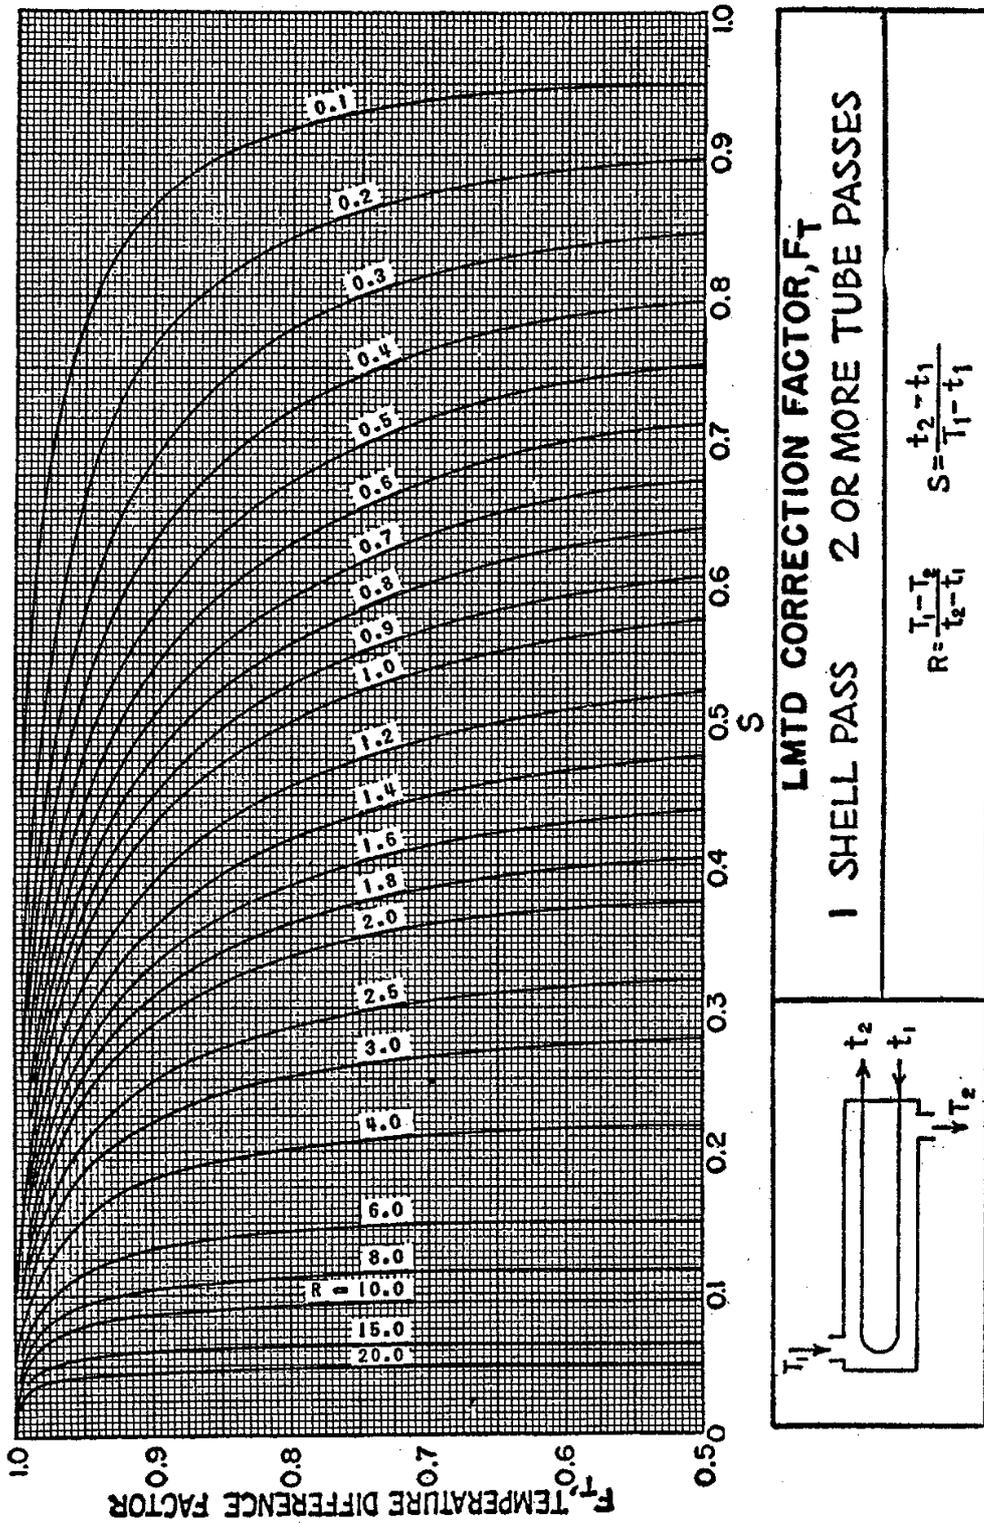


Fig. 18. LMTD correction factors for 1-2 exchangers. (Standards of Tubular Exchanger Manufacturers Association, 2d ed., New York, 1949.)

Annexe 01 : coefficient correctif pour un échangeur 1-n

APPENDIX OF CALCULATION DATA

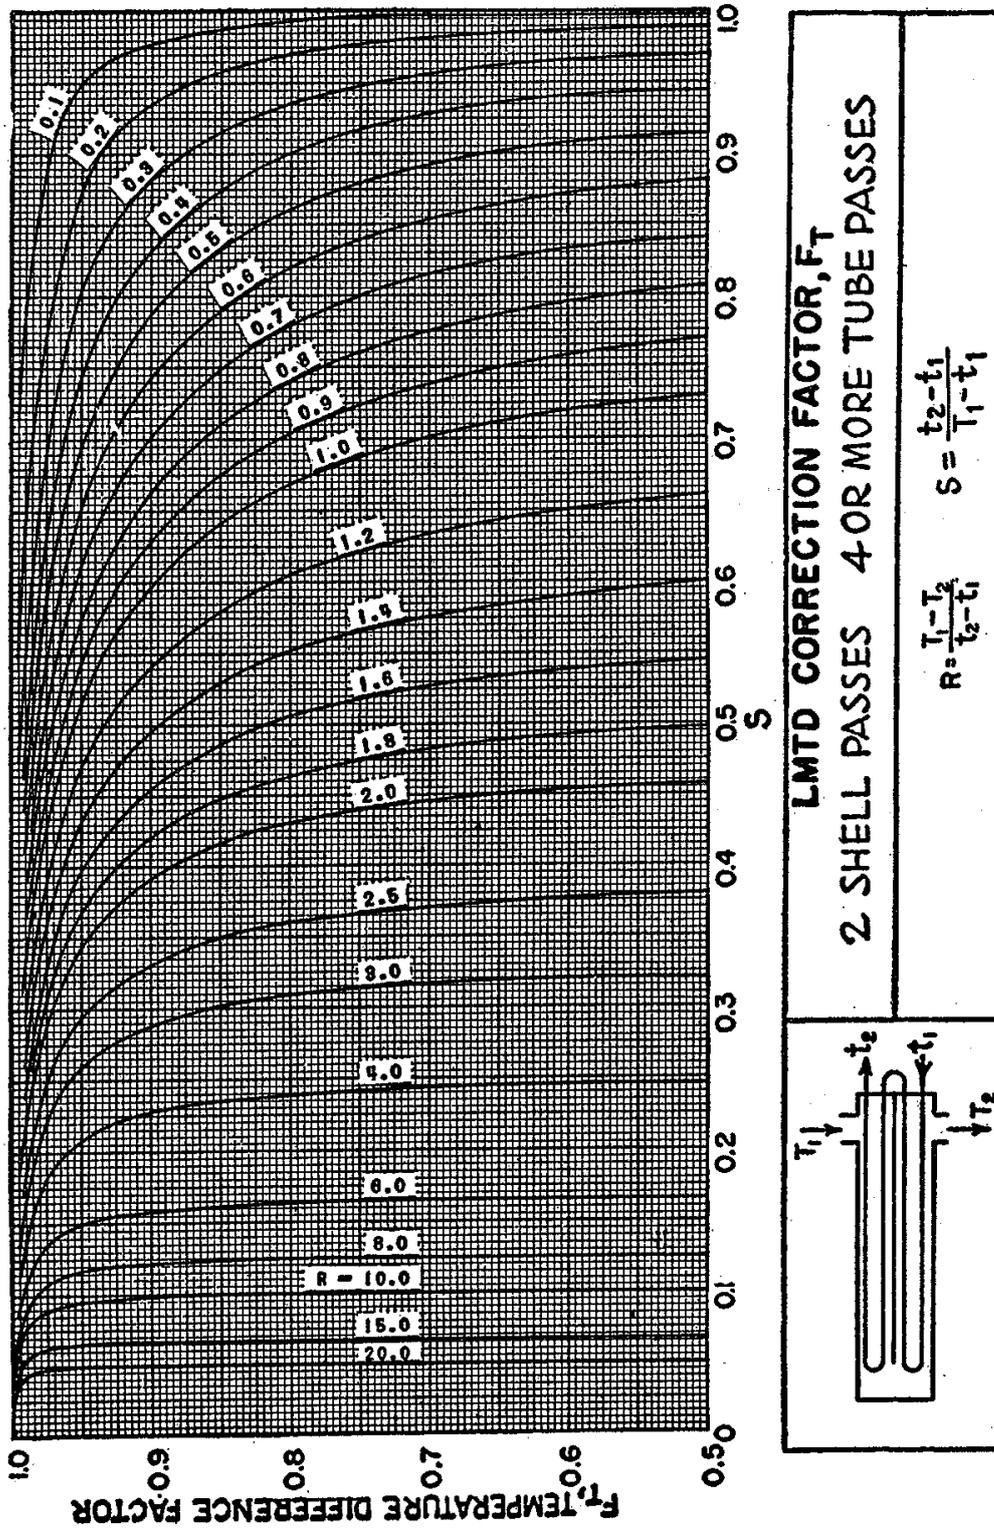


Fig. 19. LMTD correction factors for 2-4 exchangers. (Standards of Tubular Exchanger Manufacturers Association 2d ed., New York, 1949.)

Annexe 02 : coefficient correctif pour un échangeur 2-n

PROCESS HEAT TRANSFER

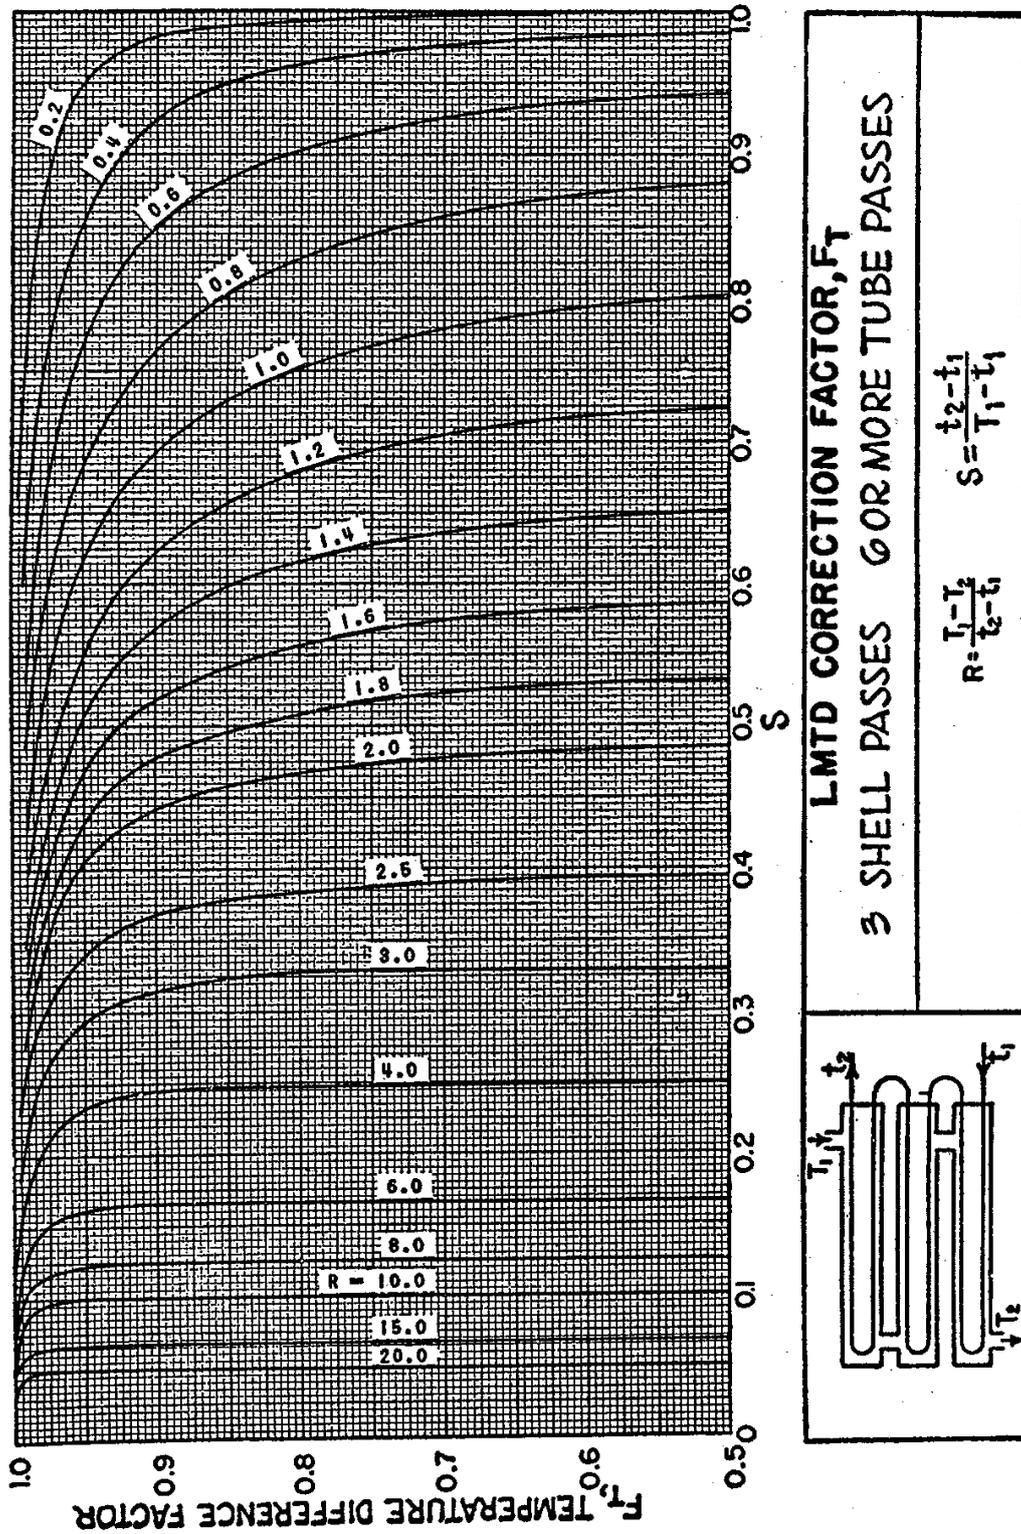


Fig. 20. LMTD correction factors for 3-6 exchangers. (Standards of Tubular Exchanger Manufacturers Association, 2d ed., New York, 1949.)

Annexe 03 : coefficient correctif pour un échangeur 3-n



PROCESS HEAT TRANSFER.

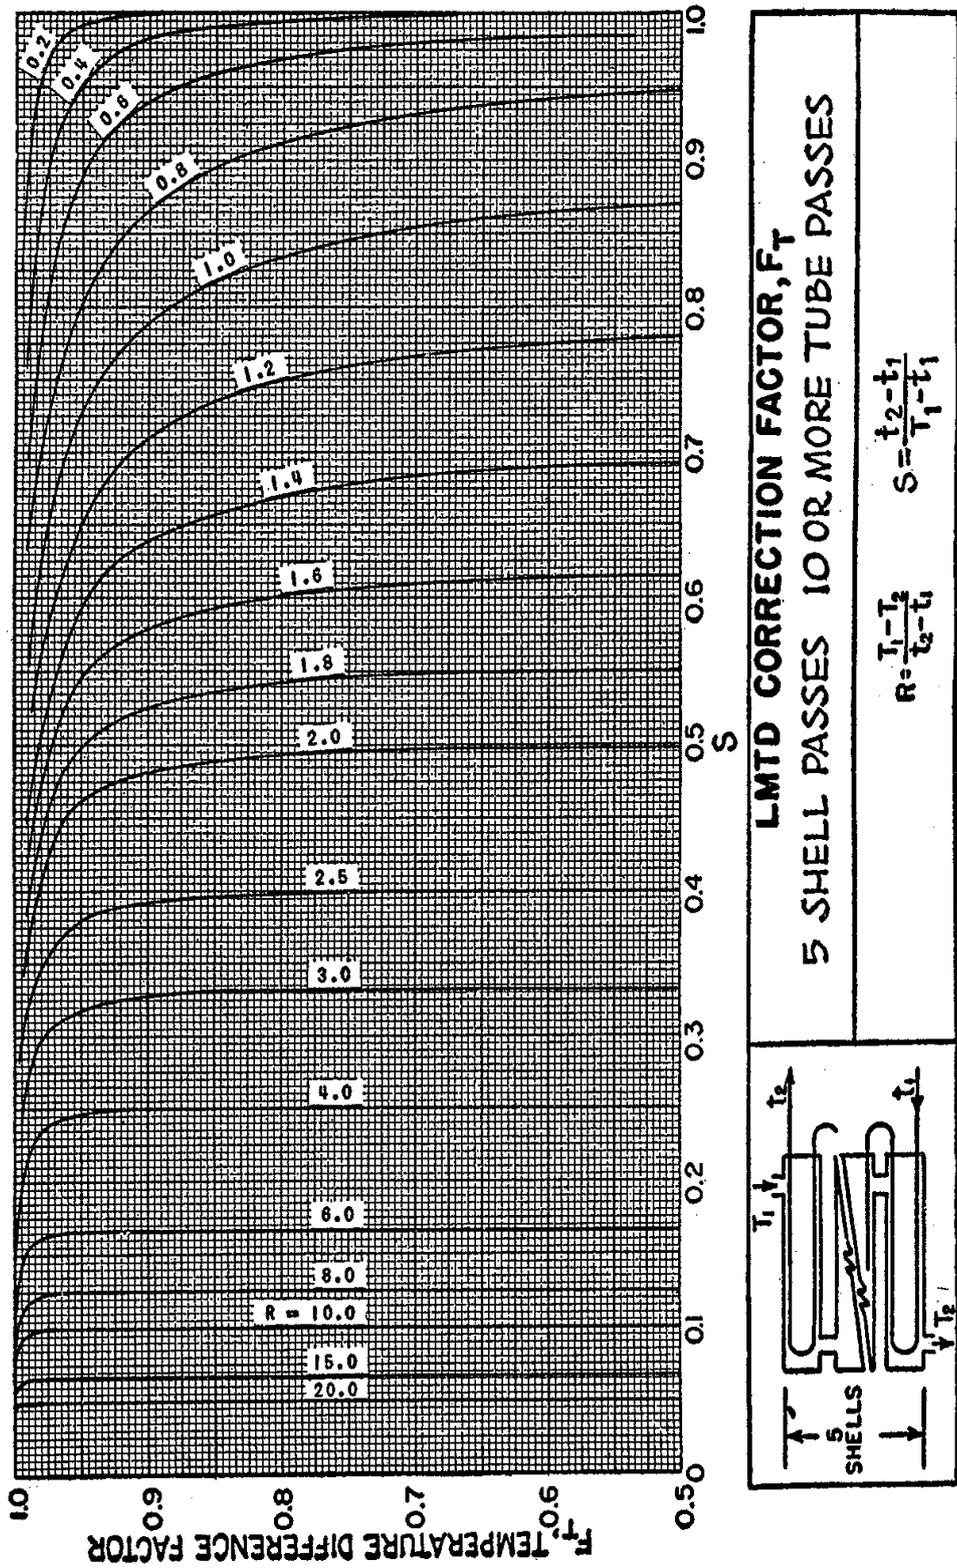


Fig. 22. LMTD correction factors for 5-10 exchangers. (Standards of Tubular Exchanger Manufacturers Association, 2d ed., New York, 1949.)

Annexe 05 : coefficient correctif pour un échangeur 5-n

APPENDIX OF CALCULATION DATA

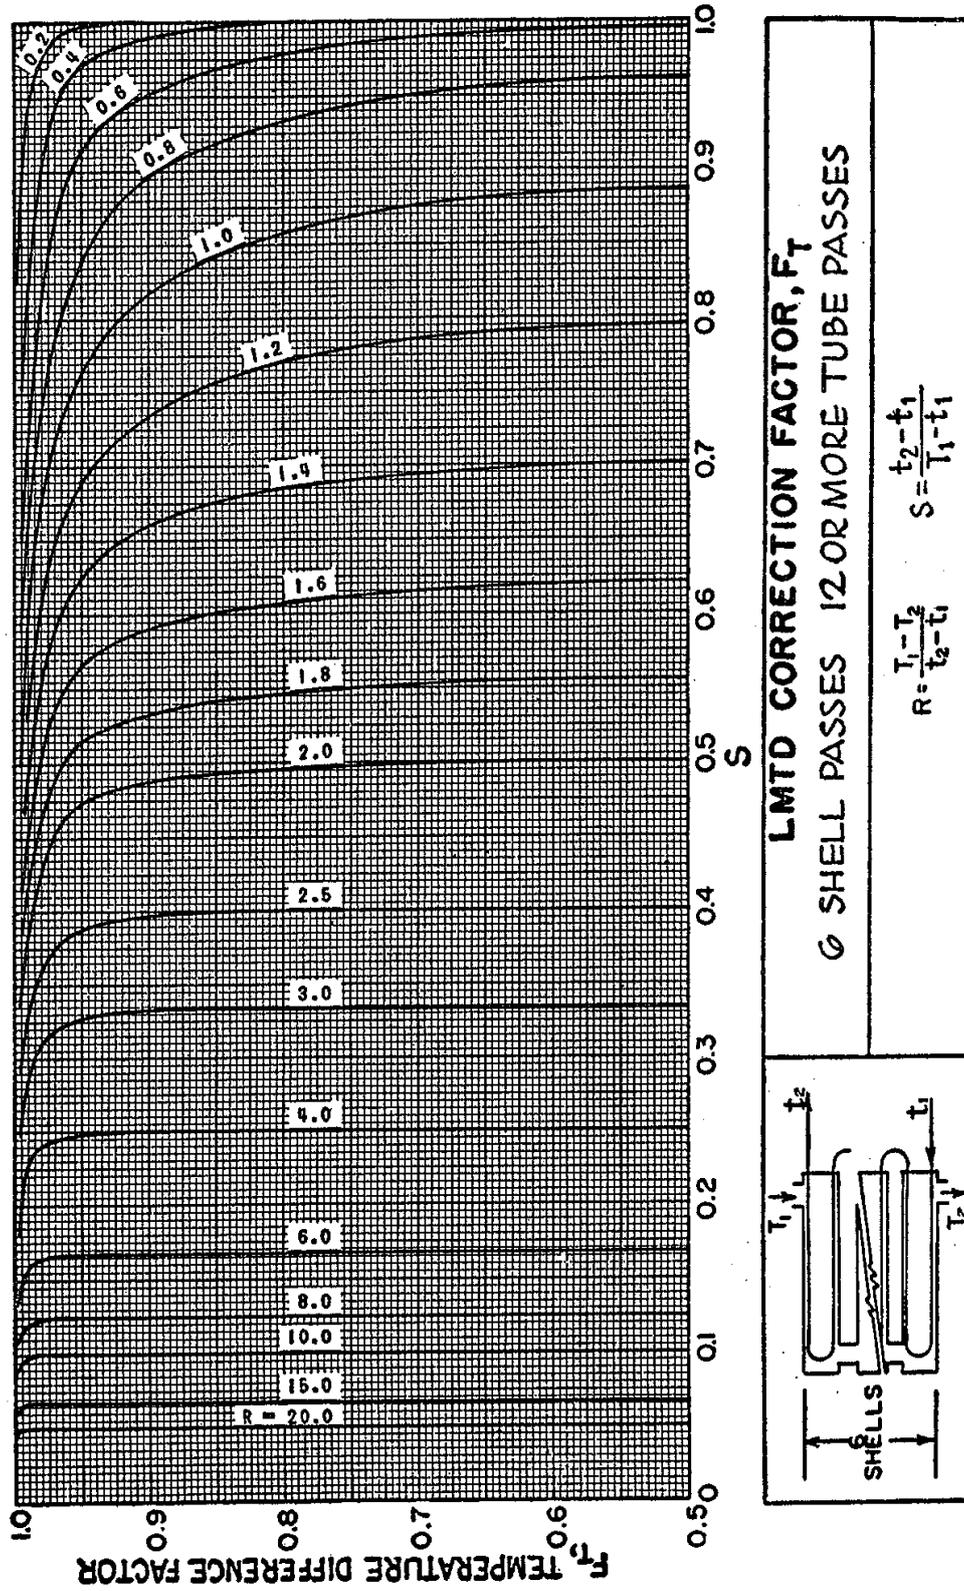


Fig. 23. LMTD correction factors for 6-12 exchangers. (Standards of Tubular Exchanger Manufacturers Association, 2d ed., New York, 1949.)

Annexe 06 : coefficient correctif pour un échangeur 6-n